


# CERTIFICATE OF SEISMIC COMPLIANCE

Evolution Motor Control Centers

Qualified to IEEE-693-2005

Qualified to IBC-2006

$S_{ds} = 1.33g$ ,  $S_s = 200\%$ ,  $I_p = 1.5$ , for  $z/h > 0$   
 $S_{ds} = 2.0g$ ,  $S_s = 300\%$ ,  $I_p = 1.5$ , for  $z/h = 0$   
in accordance with ICC-ES-AC156.

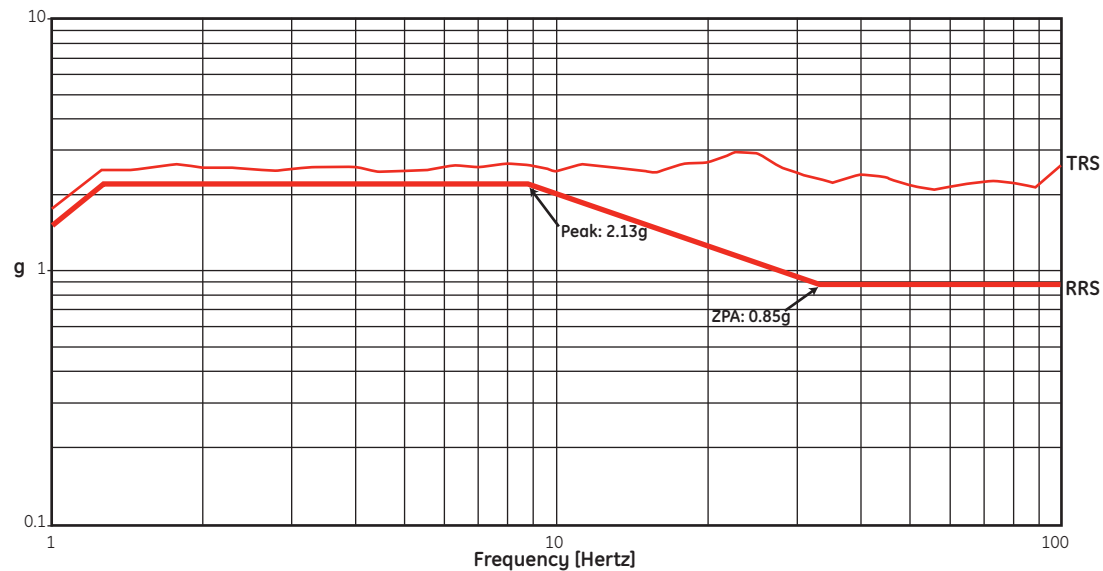

Lowest equipment natural frequency: 4.1 Hz    Qualified by shake-table testing, Wyle Laboratories, Dec. 2005,  
Clark Dynamic Test Laboratory, Dec. 2008

**THIS IS TO CERTIFY THAT THE ABOVE NAMED EQUIPMENT MEETS OR EXCEEDS ALL OF THE ABOVE REQUIREMENTS ACCORDING TO IEEE-693-2005 AND IBC-2006.**

Certification Report Prepared by

**W. E. Gundy & Associates, Inc.**  
P.O.Box 2900, Hailey, ID, 83333

See GE document 10095801P2 for Certification Report, interpretation of test data and P.E. stamp.

